SAMPLE SCHEMATIC : DRAWING REFERENCE : pa- ip system 3

SAMPLE APPLICATION FOR CENTRALISED SYSTEM ie SCHOOLS, PUBCLIC PARKS WITH OUTDOOR SPEAKERS AND WIRELESS CONNECTIVITY

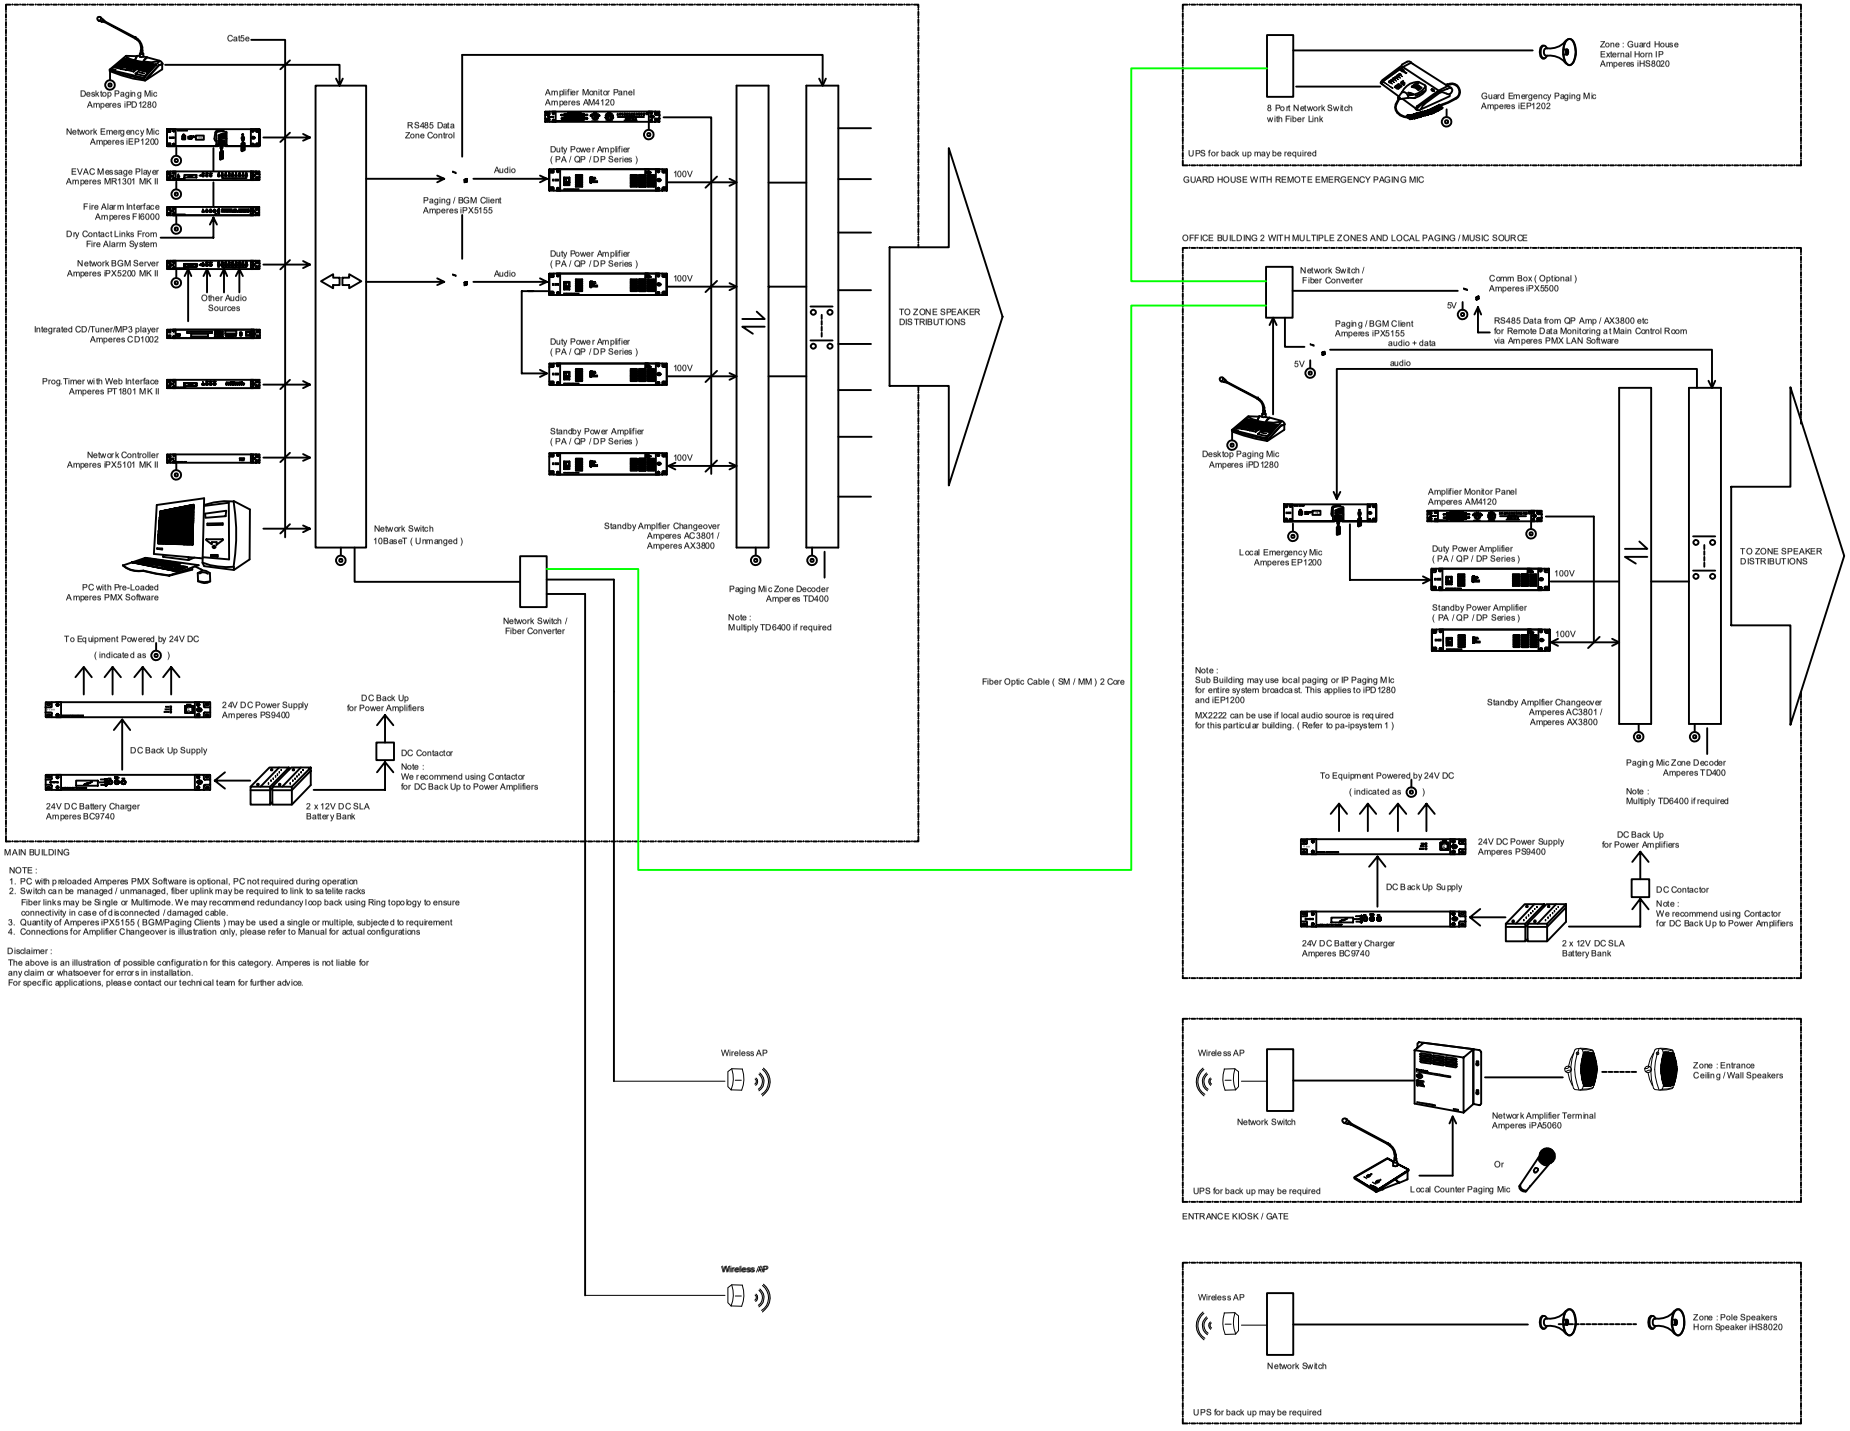

MAIN BUILDING

NOTE :

1. PC with preloaded Amperes PMX Software is optional, PC not required during operation
2. Switch can be managed / unmanaged, fiber uplink may be required to link to satellite racks
   Fiber links may be Single or Multimode. We may recommend redundancy loop back using Ring topology to ensure connectivity in case of disconnected / damaged cable.
3. Quantity of Amperes iPX5155 (BGM/Paging Clients) may be used a single or multiple, subjected to requirement
4. Connections for Amplifier Changeover is illustration only, please refer to Manual for actual configurations

Disclaimer :

The above is an illustration of possible configuration for this category. Amperes is not liable for any claim or whatsoever for errors in installation.
For specific applications, please contact our technical team for further advice.